

Cerberus™ PRO

Fire control panel



Compact, pre-assembled fire control panel with integrated, user-friendly operating unit.


- Fire control panel for a maximum of 504 addresses
- Optional, integrated single-sector extinguishing
- Can be used as a standalone version or networked with up to 64 stations, such as control panels and terminals
- Redundant network node with degraded mode operation according to EN 54
- Emergency power supply for emergency operating time of up to 72 hours
- Detection and automatic importing (auto-configuration) of all C-NET devices, ready for operation immediately
- Flexible configuration of complex applications and controls
- Configuration data can be uploaded/downloaded via remote access
- Extensions: Printer, key switches, LED indicators
- Time and situation-dependent changeover of detector parameter sets



System

i

The diagrams have been simplified and do not include additional network hardware or security components. Permissible applications are described in the A6V101039439 Network Security Guidelines document. Contact your Siemens IT security expert for more information.

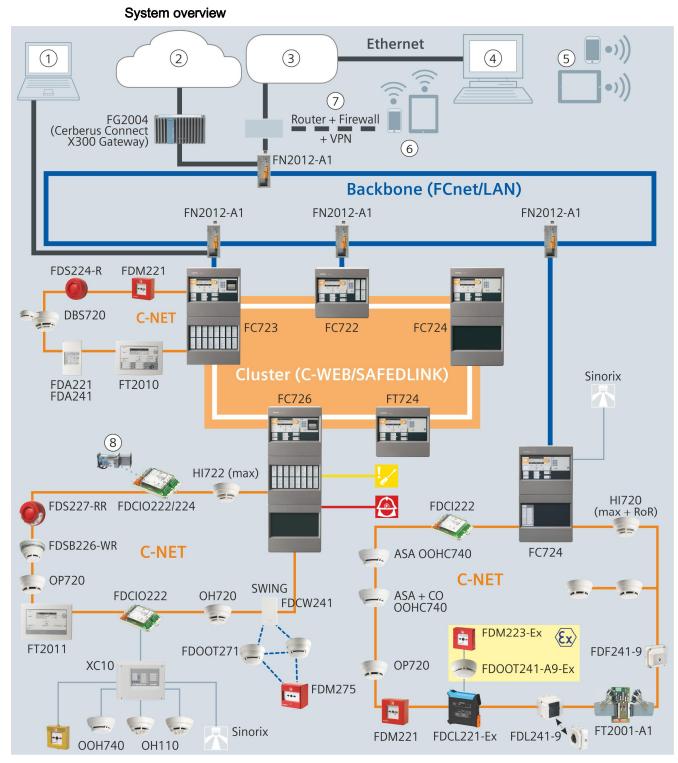

System overview


1	Remote access with Cerberus-Remote
2	FS cloud applications
3	Customer network
4	Management platform
5	Remote access to management platform
6	Remote access with Cerberus Mobile
7	Router + firewall + virtual private network
8	Fire damper with actuator
!	Transmission of a fault signal
	Transmission of an alarm signal

You will find a detailed labeled version of the diagram above along with further information in the A6V10332842 planning guide, see chapter 'Product documentation'.



The diagrams have been simplified and do not include additional network hardware or security components. Permissible applications are described in the A6V101039439 Network Security Guidelines document. Contact your Siemens IT security expert for more information.


Up to 32 control panels and terminals can be linked to form one C-WEB network. If the C-WEB network is connected to a danger management system via BACnet, up to 16 control panels and terminals can be networked.

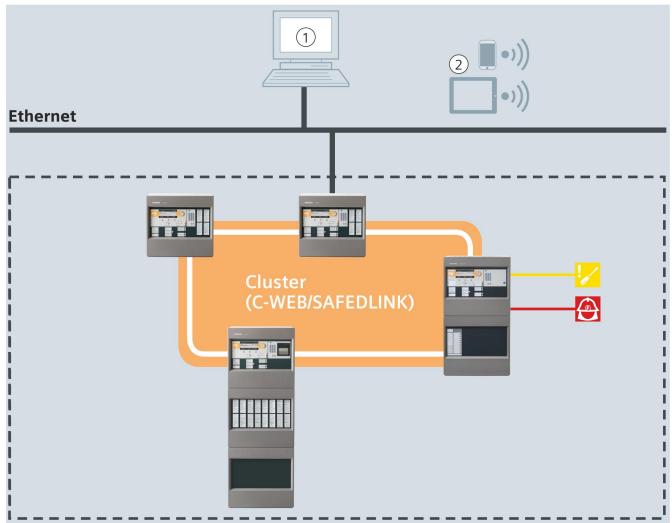

Sub-net

1	Management platform
2	Remote access to management platform
!	Transmission of a fault signal
	Transmission of an alarm signal

An optical C-WEB/LAN network allows up to 14 sub-nets with up to 16 stations to be operated in one network. A maximum of 64 stations is supported in total.

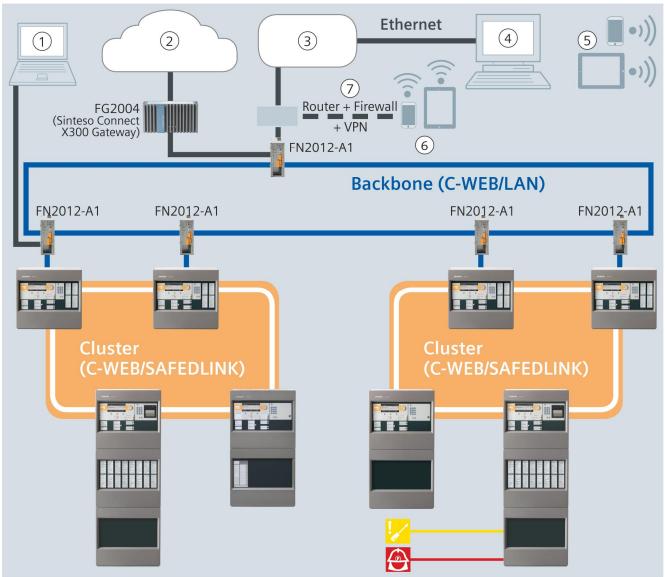

Backbone

1	Remote access with Cerberus-Remote
2	FS cloud applications
3	Customer network
4	Management platform
5	Remote access to management platform
6	Remote access with Cerberus Mobile
7	Router + firewall + virtual private network
!	Transmission of a fault signal
$\textcircled{\begin{tabular}{lllllllllllllllllllllllllllllllllll$	Transmission of an alarm signal

You will find a detailed labeled version of the diagram above along with further information in the A6V10332842 planning guide, see chapter 'Product documentation'.

Ĭ

General features and functions

- Fast Ethernet interface for a heterogeneous network
- Process signals from Cerberus PRO
- Siemens danger management system can be connected
- Slots for RS232 and RS485 serial interfaces
- Floor repeater devices, alarm devices, and mimic displays on the C-NET detector line
- All detector lines are monitored for ground faults.
- Integrated degraded mode function
- Freely configurable, time-dependent controls with optional weekly switching programs
- Time and situation-dependent changeover of detector parameter sets
- Controls for synchronous activation of sounders / sounder bases with signal sound, flash, and voice output
- The control panel and the fire detection system are custom-configured using the 'Cerberus-Engineering-Tool' software
- Firmware for all processor-controlled control panel components can be updated
- Customer texts can be adapted directly on the operating unit of the control panel or with the 'Cerberus-Engineering-Tool' software
- Up to 13000 events can be called up from the event memory and filtered based on various criteria
- Automatic summer/normal time changeover

Control panel-specific features

You will find information on the integrated extinguishing system and the individual extinguishing components that are available in a separate data sheet with the document ID 'A6V10880701'.

FC724-ZA	Housing (Comfort)
	C-NET detector line: 504 addresses 4 loops/8 stubs Features: Operating unit Operating add-on (empty) 150 W power supply Max. battery capacity 25 Ah 1 flooding zone (optional)
	Operating unit options: • Event printer FTO2001-A1 • Key switch (Kaba) FTO2005-C1 • Key switch (nordic) FTO2006-B1 • Operating add-on (2xLED indicator) FCM7213-Y3 • Operating add-on (4xLED indicator) FCM7214-Y3 • Exting. terminal (1 sector) XCM2002-A2

FC724-ZE	Housing (Comfort)
	C-NET detector line: 504 addresses 4 loops/8 stubs Features: Operating unit Operating add-on (2xLED indicator) 150 W power supply Max. battery capacity 25 Ah Operating unit options: Event printer FTO2001-A1 Key switch (Kaba) FTO2005-C1 Key switch (nordic) FTO2006-B1

Extensions

i	You will find information on the integrated extinguishing system and the individual extinguishing components that are available in a separate data sheet with the document ID 'A6V10880701'.

FCM7213-Y3	Operating add-on (2xLED indicator)
	 Optional operating add-on with 48 indicator groups with one red/green + one yellow LED each

FCM7214-Y3	Operating add-on (4xLED indicator)
	 Optional operating add-on with 96 indicator groups with one red/green + one yellow LED each

FH7202-Z3	Housing (Standard)
	 Empty housing for free use 430 x 398 x183 mm E.g., for extra batteries, operating add-ons, or event printers Space for the following battery configurations: 2x FA2003-A1 (7 Ah) or 2x FA2004-A1 (12 Ah)

FH7203-Z3	Housing (Comfort)
	 Empty housing for free use 430 x 796 x 183 mm E.g., for extra batteries, operating add-ons, or event printers Space for the following battery configurations: 2x FA2003-A1 (7 Ah) or 2x FA2004-A1 (12 Ah) or 2x FA2005-A1 (17 Ah) or 2x BAT12-25 (25 Ah)

FTO2001-A1	Event printer
	 Thermal printer for installation in operating units or operating add-ons Can be controlled via the RS232 module FCA2001-A1 (order separately) Logs all important events, such as alarms, faults, isolations, and test functions

DL3750+	Matrix printer (external)
	 External matrix printer recommended by Siemens Supports monitoring for printing faults Can be controlled via the RS232 module FCA2001-A1 (order separately) Can be controlled via Ethernet via the print server PS104 from SEH

Use

This fire control panel is ideal for medium-sized applications, e.g., for use in industrial plants, regional banks, or office complexes.

Thanks to the flexible networking options, the Station can also be used for large-scale sites.

Function elements

Operating unit

The following elements are available on the operating unit:

- CPU module and electronics
- Ethernet connection
- Slots for RS232 and RS485 modules and network modules (SAFEDLINK)
- Space for 'Kaba' or 'nordic' key switch
- Space for event printer (depending on version)
- Peripheral data bus connection for optional LED modules

Periphery board

The following elements are available on the periphery board:

- Connection terminals for:
 - C-NET lines
 - Remote transmission (alarm, fault)
 - Horn output
 - Configurable control inputs and outputs
 - Monitored alarm and fault output
 - Power supply and emergency supply
- 2x slot for loop extension (C-NET)

Power supply unit 150 W, emergency power supply

The power supply feeds the hardware and charges the batteries. In the event of a power cut, the batteries provide emergency current.

Housing

A pivoting mounting plate can be fitted for the following elements above the periphery board on the rear housing panel:

- 1x fire brigade periphery module (for Germany)
- 2x sounder module (as an alternative to mounting on U-rail TS35)

Configuration


The following software allows the system to be customized:


• Cerberus-Engineering-Tool

Operation

Each control unit has an integrated operating unit. The control panel can also be operated via a separate fire terminal FT724.

You will find details and more information in product data sheet A6V10207898.

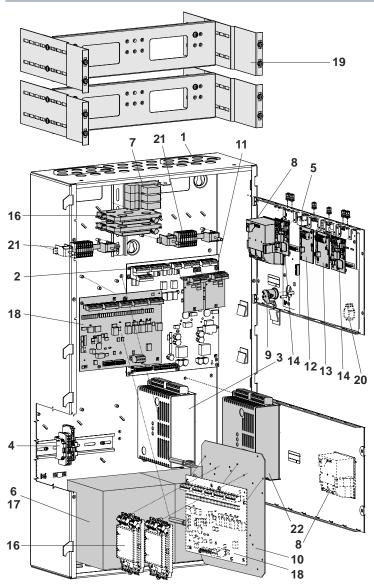



Layout of FC724 Comfort

Position	Designation	Туре	Comment
Basic equ	lipment		·
1	Housing (Comfort)	FH7203-Z3	Items 1-5: Basic equipment for each FC724-xx
2	Periphery board (4 loops)	FCI2004-A1	(Comfort)
3	Power supply (SV 24 V-150 W)	V24230-Z6-A5	
4	Mains terminals on TS35 DIN rail	-	Space for socket, relay modules, etc.
5	Operating unit	FCM72x-xx	Operating unit with CPU
6	Space for batteries	-	2x 12 V / 17 25 Ah
Extensior	is in the second s		
7	Relay module	Z3B171	Relay for fire controls
8	Event printer	FTO2001-A1	For logging events
9	Key switch (Kaba)	FTO2005-C1	For operating access authorization
	Key switch (nordic)	FTO2006-B1	
10	Mounting plate	FHA2007-A1	E.g., for fire brigade periphery module
11	Loop extension (C-NET)	FCI2003-A1	For extending the number of loops from two to four, the number of addresses remains the same
12	RS485 module (isolated)	FCA2002-A1	For peripheral devices with RS485 interface
13	RS232 module (isolated)	FCA2001-A1	For devices with an RS232 interface
14	Network module (SAFEDLINK)	FN2001-A1	For networking several stations
15	Repeater (SAFEDLINK)	FN2002-A1	For extending the C-WEB system bus, max. 1x repeater (SAFEDLINK) between two stations (mounted directly on a plane surface, on a TS35 U-rail, or in housing FDCH221)
16	Sounder module	FCA2005-A1	For splitting one conventional sounder into four
17	Battery (12 V, 17 Ah, VdS)	FA2005-A1	For the emergency power supply
	Battery (12 V, 25 Ah, VdS)	BAT12-25	-
18	Fire brigade periphery module	FCI2001-D1	For Germany (FBF, FSD, ÜE, FSE, ÖA, KL)
19	19" mounting kit	FHA2016-A1	For installation in 19" third-party housing
20	License key Sx	FCA20xx	For special functions
21	Cable kit (communication)	FCA2014-A1	For flexible connections running to the modules on the operating unit
22	Power supply kit (150 W, B)	FP2005-A1	For extra power supply

Type Overview			
	Housing	(Comfort)	
		<page-header></page-header>	
Туре	FC724-ZA	FC724-ZE	
Order number	S54400-C30-A2	S54400-C30-A3	
Number of C-NET addresses	504		
Number of lines:			
Loops (with loop extension) or	4 (8)		
Stubs (with loop extension)	8 (16)		
Power supply	supply 150 W		
Max. battery capacity	26	Ah	
Indicator groups with one red/green + one yellow LED each	-	48	

i

Control panels

Туре	Designation	Weight	Order number
FC724-ZA	Fire control panel (4 loops)	15.061 kg	S54400-C30-A2
FC724-ZE	Fire control panel (4 loops)	15.313 kg	S54400-C30-A3

Extensions

You will find information on the integrated extinguishing system and the individual extinguishing components that are available in a separate data sheet with the document ID 'A6V10880701'.

Туре	Designation	Weight	Order number
FCA2001-A1	RS232 module (isolated)	0.033 kg	A5Q00005327
FCA2002-A1	RS485 module (isolated)	0.027 kg	A5Q00009923
FCA2005-A1	Sounder module	0.100 kg	A5Q00014866
FCA2014-A1	Cable kit (communication)	0.126 kg	A5Q00023027
FCI2001-D1	Fire brigade periphery module	0.207 kg	A5Q00013100
FCI2003-A1	Loop extension (C-NET)	0.030 kg	A5Q00010136
FCM7213-Y3	Operating add-on (2xLED indicator)	2.516 kg	S54400-B149-A1
FCM7214-Y3	Operating add-on (4xLED indicator)	3.905 kg	S54400-B150-A1
FH7202-Z3	Housing (Standard)	7.268 kg	S54400-B70-A1
FH7203-Z3	Housing (Comfort)	12.874 kg	S54400-B71-A1
FHA2007-A1	Mounting plate	0.800 kg	A5Q00010151
FHA2016-A1	19" mounting kit	3.000 kg	A5Q00020179
FN2001-A1	Network module (SAFEDLINK)	0.022 kg	A5Q00012851
FN2002-A1	Repeater (SAFEDLINK)	0.105 kg	S24236-B2502-A1
FN2006-A1	Fiber network module (SM)	0.792 kg	S54400-A109-A1
FN2007-A1	Fiber network module (MM)	0.792 kg	S54400-A110-A1
FTO2001-A1	Event printer	0.141 kg	A5Q00010126
-	Spare printer reels (10 reels)	0.090 kg	A5Q00017619
FTO2005-C1	Key switch (Kaba)	0.083 kg	A5Q00010113
FTO2006-B1	Key switch (nordic)	0.046 kg	A5Q00010129
Z3B171	Relay module 250 V AC / 10 A (1 relay)	0.042 kg	4843830001

Auxiliary power supply

Туре	Designation	Weight	Order number
FP2003-A1	Power supply kit (70 W) Phased out, do not use	0.650 kg	A5Q00016005
FP2004-A1	Power supply kit (150 W, A) for EN-compliant installation in empty housing	1.286 kg	A5Q00020825
FP2005-A1	Power supply kit (150 W, B) for extension	1.181 kg	A5Q00018779

Network (backbone)

Туре	Designation	Weight	Order number
FCA2031-A1	Connection module (MoNet)	0.081 kg incl. cable	S54400-A153-A1
FHA2029-A1	Mounting kit (switch)	1.261 kg	S54400-B79-A1
FN2012-A1	Ethernet switch (modular)	0.600 kg	S54400-B152-A1
VN2002-A1	Ethernet module (MM)	0.026 kg	S54400-A43-A1
VN2003-A1	Ethernet module (SM)	0.026 kg	S54400-A44-A1

Batteries

Туре	Designation	Weight	Order number
FA2003-A1	Battery (12 V, 7 Ah, VdS)	2.350 kg	A5Q00019353
FA2004-A1	Battery (12 V, 12 Ah, VdS)	3.750 kg	A5Q00019354
FA2005-A1	Battery (12 V, 17 Ah, VdS)	5.700 kg	A5Q00019677
BAT12-25	Battery (12 V, 25 Ah, VdS)	7.8 kg	S54302-Z102-A1
FHA2061-A1	Mounting kit (batteries)	-	S54400-B91-A1

License keys

Туре	Designation	Weight	Order number
FCA2033-A1	License key (S1)	0.010 kg	S54400-P154-A1
FCA2034-A1	License key (S2)	0.010 kg	S54400-P155-A1
FCA2035-A1	License key (S3)	0.010 kg	S54400-P156-A1
FCA2036-A1	License key (S4)	0.010 kg	S54400-P157-A1

External printer

Туре	Designation	Weight	Order number
DL3750+	Matrix printer (external)	7.300 kg	A5Q00023962
-	Color ribbon for matrix printer DL3750+	0.078 kg	A5Q00023963

Title	Document ID
System documentation	
System description	A6V10210355
Product data	A6V10210368
Planning	A6V10210362
Mounting/Installation	A6V10210390
Data sheets	
FC721 - fire control panel	A6V10203220
FC722 - fire control panel	A6V10206525
FC723 - fire control panel for modernization	A6V10379246
FC724 - fire control panel	A6V10207176
FC726 - fire control panel (modular)	A6V10263277
FT724 - fire terminal	A6V10207898
Fire detection system with integrated single-sector extinguishing	A6V10880701
Network Security Guidelines	A6V101039439
Planning overview	A6V10332842

Related documents such as environmental declarations, CE declarations, etc., can be downloaded at the following Internet address: http://siemens.com/bt/download

Guarantee

Technical data on specific applications are valid only together with Siemens products listed under "Equipment combinations". Siemens rejects any and all warranties in the event that third-party products are used.

FC724 in the housing (Comfort)	
Supply	
Mains voltage	AC 115 / 230 V +10/-15 %
Power supply	150 W
Operating voltage	DC 2128.4 V
Operating current	Max. 5 A
Battery capacity	2x 12 V, 25 Ah
Battery monitoring	Yes
Network monitoring	Yes
Inputs / outputs	·
Connectable detector series	Cerberus PRO (C-NET)
Number of addresses	Max. 504
Number of integrated line cards	2
Number of lines:	
Loops (with loop extension) or	4 (8)
Stubs (with loop extension)	8 (16)
Integrated inputs/outputs:	
Alarm RT relay output	1
Fault RT relay output	1
Monitored alarm outputs	1
Monitored fault outputs	1
Monitored horn outputs	2
• Freely programmable inputs/outputs	12
Interfaces	
Operating unit	Integrated
Slots for serial interfaces RS232, RS485	2
Slots for network modules	2
Slot for loop extension	2
Mounting space for cable kit (communication)	2
Sounder module	Max. 2
Ethernet port RJ45	1
Ambient conditions	
Operating temperature	-8+42 °C
Storage temperature	-20+60 °C
Air humidity (no condensation permitted)	≤95 % rel.
Maximum height above sea level	3700 m

Mechanical data		
Dimensions (W x H x D):		
Without cover cap	430 x 796 x 160 mm	
With cover cap	430 x 796 x 183 mm	
Protection category (IEC 60529)	IP30	
Color:		
Housing	~RAL 7035 light gray	
Cover cap	Cover cap ~RAL 000 50 00	
Approvals	· · · · · · · · · · · · · · · · · · ·	
VdS	G209077	
LPCB	126bn/07	
FM	3051081	
DNV GL (marine)	MEDB00003US	

09 C E 0786	FC724-HA / FC724-ZA / FC724-	-ZE Siemens Schweiz AG; Theilerstrasse 1a CH-6300 Zug Technical data: see doc. A6V10210355
FC724 - Control and Indicating Equipment incl. SV24V150W - 150W/24VDC Power Supply Equipment for use in fire detection and fire alarm systems installed in buildings.		
305/2011/EU (CPR): EN 54-2 / EN 54-4 ; 2014/30/EU (EMC): EN 50130-4 / EN 61000-6-3 ; 2014/35/EU (LVD): EN 60950-1 ; 2011/65/EU (RoHS): EN 50581		
The declared performance and conformity can be seen in the Declaration of Performance (DoP) and the EU Declaration of Conformity (DoC), which is obtainable via the Customer Support Center: Tel. +49 89 9221-8000 or http://siemens.com/bt/download		
DoP No.: 0786-CPR-20722; DoC No.: CED-FC724		
13 C E 0786	SV24V150W	Siemens Schweiz AG; Theilerstrasse 1a CH-6300 Zug Sinteso technical data: see doc. 008837 Cerberus™ PRO technical data: see doc. A6V10210368
SV24V150W - Power Supply Equipment 24VDC/150W for use in fire detection and fire alarm systems installed in buildings.		
305/2011/EU (CPR): EN 54-4 ; 2014/30/EU (EMC): EN 50130-4 / EN 61000-6-3 ; 2014/35/EU (LVD): EN 60950-1 ; 2011/65/EU (RoHS): EN 50581		
The declared performance and conformity can be seen in the Declaration of Performance (DoP) and the EU Declaration of Conformity (DoC), which is obtainable via the Customer Support center: Tel. +49 89 9221-8000 or http://siemens.com/bt/download		
DoP No.: 0786-CPD-20775; DoC No.: CED-SV24V150W		

Issued by Siemens Switzerland Ltd Building Technologies Division International Headquarters Theilerstrasse 1a CH-6300 Zug Tel. +41 58 724 2424 www.siemens.com/buildingtechnologies