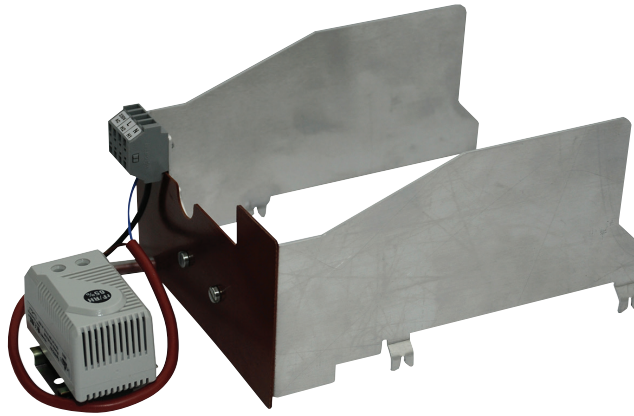


Heating with mechanical humidistat to preclude the formation of condensation water in actuators with IP66/NEMA4 protective housing

- Nominal voltage AC/DC 24 V
- Humidistat permanently set (65% r.H.)
- Note: The combination of heating with humidistat can not be ordered as accessories


Technical data

| | | |
|------------------------|-----------------------------------|--|
| Electrical data | Nominal voltage | AC/DC 24 V |
| | Nominal voltage range | AC 19.2...28.8 V / DC 21.6...28.8 V |
| | Connection supply / control | Terminals (cable 0.75...1.5 mm ² , 2-wire) |
| | Type of contact | Normally open contact |
| | Heating output | 21 W |
| | Switch-on current | Max. 6 A |
| Functional data | Service life | >100,000 cycles |
| | Switching accuracy | ±5% r.H. |
| | Switching differential (humidity) | 4% r.H. (±3% tolerance) |
| | Heating element | Positive temperature coefficient resistor (PTC), self-regulating, temperature-limiting |
| | Settings | 65% r.H. fixed |
| Safety | EMC | CE according to 2014/30/EU |
| | Ambient temperature | according to IP66/NEMA4 damper actuator |
| | Non-operating temperature | according to IP66/NEMA4 damper actuator |
| Materials | Heater | Aluminium profile, anodised |

Safety notes


- It is absolutely imperative that operators ensure that both heating device and actuator are disconnected from the voltage source before settings or manipulations are carried out on the device.
- The heating device itself is not permitted to be removed. The entire actuator must be replaced when repair or warranty work is being performed!
- The following points must be taken into account with independent, external wiring:
 - All contact between the cables or wires that are introduced and the heating element is to be avoided.
 - Where necessary, use cables with sufficient numbers of wires, so that e.g. the heating and the actuator can be supplied separately with voltage (see «Electrical Installation»).
 - All legal regulations or regulations issued by authorities must be observed.


Product features

- Application** The humidistat records the amount of dampness in the ambient air inside the actuator housing and switches the connected heating system on when the permanently set air humidity level of 65% r.H. is exceeded. This prevents the formation of condensation on assemblies and electronic components.

Electrical installation

Wiring diagrams

Examples of external wiring with actuator types ..24G..

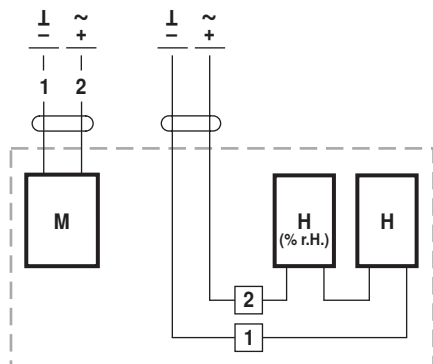

M = Actuator
 H (% r.H.) = Humidistat
 H = Heating