SIEMENS 4⁸⁵⁵



VPP46..Q, with pressure test points P/T VPI46..Q, with pressure test points P/T

ACVATIX™

Combi valves, PN 25

VPP46..Q VPI46.. VPI46..Q

for rooms, zones, ventilation and air-conditioning systems

- With integrated differential pressure controller
- DN 10...DN 32: Valve body made of dezincification resistant hot-pressed brass (DZR)
- DN 40...DN 50: Housing made of spheroidal graphite iron
- Volumetric flow 30... 11500 I/h,
- Differential pressure range 15...600 kPa
- Internally threaded Rp conforming to ISO 7-1
- Externally threaded G conforming to ISO 228-1
- Version with pressure test points for Δp measurement (optional)
- Can be equipped with electro thermal or electromotive actuators
 - SSA.. (3-position or DC 0...10 V)
 - STA..3../STP..3.. (2-position or PDM)
 - SUA21/3, SUA21/3P, SUE21P (2-position SPST)
 - STA63../STP63.. (DC 0...10 V)
 - SAY..1P03 (3-position or DC 0...10 V)

Use

- In ventilation and air conditioning plants for control on the water side and automatic hydraulic balancing of terminal units, such as fan coils, induction units, and in heat exchangers for heating or cooling
- In heating zones like self-contained heating systems, apartments, individual rooms, etc.
- · For closed circuits

Type summary

Product no.	Stock	DN	H ₁₀₀	Con	nections	Test points	V _{min}	V ₁₀₀	SUA21/3 ²⁾ SUA21/3P	SUE21P	STA3 / STP3 ³⁾	SSA
									∆p _{max} 1)	$\Delta p_{\text{max}}^{1)}$	∆p _{max} 1)	∆p _{max} ¹)
			[mm]	[inch]			[l/h]	[l/h]	[kPa]	[kPa]	[kPa]	[kPa]
VPP46.10L0.2	S55264-V101		2.5				30	200	600	-	600	600
VPP46.10L0.4	S55264-V131	10	4.5 5	G ½			65	333 370	-	600	-	-
VPP46.15L0.2	S55264-V102	45		0.27			30	200	200			600
VPP46.15L0.6	S55264-V103	15	2.5	G ¾			100	575	600	-	600	
VDD 40 0054 4	0550043/404		4.5				200	1190				-
VPP46.20F1.4	S55264-V104	20	5	G 1		-	220	1330	-	600	-	600
			4.5				238	1530		-	600	-
VPP46.25F1.8	S55264-V121	25	5	G 11/4			260	1670	-	600	-	-
			5.5				280	1800			_	600
			4.5				468	3400		-	600	-
VPP46.32F4	S55264-V122	32	5	G 1½			510	3700	_	600	-	_
			5.5	1 .,_	externally		550	4001		-	_	
VPP46.10L0.2Q	S55264-V105		2.5		1		30	200	600	_		600
VII 40.1020.2Q	000204 1100	10	4.5	G ½	threaded		- 00	333	000	_	600	_
VPP46.10L0.4Q	S55264-V132	10	5	0 /2			65	370	-	600	_	
VPP46.15L0.2Q	S55264-V106		<u> </u>				30	200		000	_	600
VPP46.15L0.2Q		15	2.5	G 3/4				575	600	-	600	000
VPP46.15LU.6Q	333204-V 107		1 E				100				600	
VPP46.20F1.4Q	S55264-V108	20	4.5 5	G 1		with pres-	200	1190	-	-		-
						sure test	220	1330		600	-	600
\(\text{DD 40 0== 4 00}\)	S55264-V123	0.5	-	4.5		points P/T	238	1530	-	-	600	-
VPP46.25F1.8Q	000204-1120	25	5	G 1¼			260	1670	-	600	-	-
			5.5				280	1800		-	-	600
	S55264-V124		4.5				468	3400		-	600	-
VPP46.32F4Q	333204-7124	32	5	G 1½			510	3700	-	600	-	-
			5.5				550	4001		-	-	600
VPI46.15L0.2	S55264-V109						30	200				
VPI46.15L0.6	S55264-V110	15	2.5	Rp ½			100	575	600	-	600	600
***************************************	300201 1110		4.5				200	1190		_		_
VPI46.20F1.4	S55264-V111	20	5	Rp 3/4			220	1330	-	600	_	600
			4.5				238	1530		-	600	-
VPI46.25F1.8	S55264-V125	25	5	Rp 1		-	260	1670	_	600	-	_
VF140.231 1.0	333204-7 123	23	5.5	i ty			280	1800	-	000	-	600
			4.5				468	3400		-	600	
VDI46 22E4	SEE364 V/136	32		Rp 1¼			510	3700	-	600		-
VPI46.32F4	S55264-V126	32	5	KP 1/4					-	600	-	-
VD14C 451 0 00	055004 1/440		5.5		internally threaded		550	4001		-	-	000
VPI46.15L0.2Q	S55264-V112	15	2.5	Rp ⅓	uncaucu		30	200	600	-	000	600
VPI46.15L0.6Q	S55264-V113						100	575			600	
VPI46.20F1.4Q	S55264-V114	20	4.5	Rp ¾			200	1190	_	-		-
			5	1 . P /4		with pres-	220	1330		600	-	600
			4.5			sure test	238	1530		-	600	-
VPI46.25F1.8Q	5.5			points P/T	260	1670	-	600	-	-		
					280	1800		-	-	600		
	0550011115		4.5				468	3400		-	600	-
VPI46.32F4Q	S55264-V128	32	5	Rp 11/4			510	3700	-	600	-	-
I			5.5			1	550	4001	1	-	-	600

 $[\]Delta p_{\text{min}}$ value refer to page 9

Smart Infrastructure

Only with mounting AL60 accessory, the SUA21/3 can drive the VPI46.. or VPP46..valve STP..3.. may only be used together with

³⁾

⁻ VPP46.10L0.2 - VPP46.10L0.2Q

⁻ VPI46.15L0.2 - VPP46.15L0.2Q - VPI46.15L0.6

⁻ VPI46.15L0.2Q

⁻ VPP46.15L0.2 - VPP46.15L0.6

⁻ VPP46.15L0.6Q

Product no.	Stock no.	DN	H ₁₀₀	Conne	ections	Test points	v _{min}	V 100	SA	YP
									Δp_{min}	Δp_{max}
			[mm]	[Inch]			[l/h]	[l/h]	[kPa]	[kPa]
VPI46.40F9.5Q	S55264-V129			Rp 1½	internally	with pres- sure test	1370	9500	25	600
VPI46.50F12Q	S55264-V130	50	15	Rp 2	threaded	points P/T	1400	11500	36	000

DN = nominal size

H₁₀₀ = nominal stroke

 $\dot{\mathbf{v}}_{100}$ = volumetric flow through fully open valve (H₁₀₀)

 \dot{v}_{min} = smallest pre-settable volumetric flow through fully open valve (H₁₀₀)

 Δp_{max} = maximum permissible differential pressure across the valves control path, valid for the entire actuating range of the motorized valve

 Δp_{min} = minimum differential pressure required across the valve's control path, so that the difference

pressure regulator works reliably

Fittings

Product no.	Stock no.	Description
ALG2	ALG2	Set of 2 fittings with threaded connections for 2-port valves, consisting of 2 union nuts, 2 discs and 2 flat seals
ALG2B	S55846-Z1	Brass fittings, for media temperatures up to 100 °C

Ordering

Example

Product no.	Stock no.	Designation
VPP46.15L0.2	S55264-V102	Combi valve, PN 25, externally threaded
SSA331	S55180-A105	Actuator

Delivery

PICV valves, actuators and accessories are packed and supplied separately.

Revision numbers

See page 18

Equipment combinations DN 15...32

Actuators	Mounting	Operating	Positionin	g	Actuators	Spring	Stroke	Connecting	Data sheet
	set	voltage	signal	force	(no power) ¹⁾	return		cable	
SSA131		AC 24 V	3-position						
SSA331		AC 230 V	5-position						A6V11858276
SSA161.05			DC 010 V				1.2 mm		
SSA151.05HF		40/00043/	DC 420 mA		-	-	6.5 mm	1.5 m	
SSA161.05HF		AC/DC 24 V	DO 0 40 V						A6V11858278
SSA161E.05HF	-		DC 010 V	100 N					
STA23		AC 230 V	2- position						
STA73		AC/DC 24V	2-position, PDM		NC				
STA63		AC 24 V	DC 010 V			√	2.5 mm max. 4.5	see data	N4884
STP23 2)		AC 230 V	2-position			•	mm	sheet	114004
STP73 ²⁾		AC/DC 24V	2-position, PDM		NO				
STP63 2)		AC 24 V	DC 010 V						
SUA21/3	AL60	AC230V	3-wire on/off	170N			2.5 mm		A6V10446174
SUA21/3P		AC230V	(SPST ¹⁾)	4001:		-	اااااا ن.ک	0.8 m	A6V11780780
SUE21P	-	AC230V	(0, 01)	100N			5mm		A6V11780777

¹⁾ NC = Normal Closed = VPP46../VPI46.. powerless closed

The valve is fully opened without an actuator

- VPP46.10L0.2 - VPP46.10L0.2Q - VPI46.15L0.2 - VPI46.15L0.2Q - VPP46.15L0.2 - VPI46.15L0.6Q

- VPP46.15L0.6 - VPP46.15L0.6Q

NO = Normal Open = VPP46../VPI46.. powerless open

²⁾ STP..3.. may only be used together with

Туре	Article no.	Stroke	Pos. force		_		Spring return di- rection	Pos. time	LED	Iadillet-	Auxiliary functions
SAY31P03	S55150-A132			AC 230 V	3-position				-		1)
SAY61P03	S55150-A133	15 mm	200 N		DC 010 V DC 420 mA 01000 Ω	-	-	30 s	√	Press and fix in place	
SAY81P03	S55150-A134				3-position				-	-	1)


¹⁾ Optional accessories: Auxiliary switch ASC10.51

Fittings

Combi valves		Set of fittings		
Externally thread	ded	Malleable cast iron	Brass	
Product no.	Stock no.	Type / Stock no.	Product no.	Stock no.
VPP46.10L0.2	S55264-V101	-	ALG132 1)	BPZ:ALG132
VPP46.10L0.4	S55264-V131	-	ALG132 1)	BPZ:ALG132
VPP46.15L0.2	S55264-V102	-	ALG142 1)	BPZ:ALG142
VPP46.15L0.6	S55264-V103	-	ALG142 1)	BPZ:ALG142
VPP46.20F1.4	S55264-V104	ALG152	ALG152B 2)	S55846-Z100
VPP46.25F1.8	S55264-V121	ALG202	ALG202B ²⁾	S55846-Z102
VPP46.32F4	S55264-V122	ALG252	ALG252B ²⁾	S55846-Z104
VPP46.10L0.2Q	S55264-V105	-	ALG132 1)	BPZ:ALG132
VPP46.10L0.4Q	S55264-V132	-	ALG132 1)	BPZ:ALG132
VPP46.15L0.2Q	S55264-V106	-	ALG142 1)	BPZ:ALG142
VPP46.15L0.6Q	S55264-V107	-	ALG142 1)	BPZ:ALG142
VPP46.20F1.4Q	S55264-V108	ALG152	ALG152B 2)	S55846-Z100
VPP46.25F1.8Q	S55264-V123	ALG202	ALG202B ²⁾	S55846-Z102
VPP46.32F4Q	S55264-V124	ALG252	ALG252B ²⁾	S55846-Z104

¹⁾ Connecting thread pipe side: Internally threaded

Technical / mechanical design

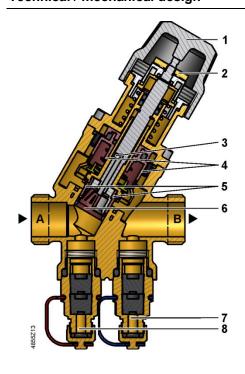

- 1 Manual control knob
- 2 Ring with dial for presetting
- 3 Aperture for differential pressure controller is linked with outlet port B
- 4 Differential pressure controller
- 5 Plug for presetting opening
- 6 Flow control valve
- 7 Pressure test point, blue ribbon, P-
- 8 Pressure test point, red ribbon, P+
- A Inlet port A
- B Outlet port B

Combi valves VP..46..Q (shown here) are additionally equipped with pressure test points P/T.


²⁾ Positioning feedback, forced control, characteristic curve changeover

³⁾ Optional accessories: Auxiliary switch ASC10.51, sequence control, control action changeover AZX61.1

Usable up to maximum medium temperature of 100 °C

Functional principle


The medium entering the valve (inlet port A) passes through the variable presetting opening (5) which is connected to the ring with the dial (2) for presetting the desired maximum volumetric flow. Then, the medium flows through the flow control valve (6) with a linear characteristic and a stroke of 2.5 mm (DN 10...15) respectively 5 mm (DN 20).



Ring with dial for presetting (2)

The actuator (not shown here) opens and accurately positions the control valve (6). Before leaving the Combi valve, the medium passes through a built-in mechanical differential pressure controller (4). This differential pressure controller is the heart of the Combi valve and ensures that the selected volumetric flow is maintained across the whole working range and independent of the inlet pressure p₁.

The Combi valves VP..46..Q are additionally equipped with two pressure test points (P+, P-), which allow measurement of the differential pressure across the Combi valve. For that purpose, the electronic manometer ALE10 can be used.



- A Inlet medium (inlet port)
- B Outlet medium (outlet port)
- 2 Ring with dial for presetting
- 4 Differential pressure controller maintains the pressure p₁ – p₂ constant across the flow control valve (6) and the presetting (2)
- 6 Control valve with mounted actuator

P- = P/T port, pressure test point with blue ribbon (7)

P+ = P/T port, pressure test point with red ribbon (8)

p₁ = pressure at inlet of Combi valve

p₂ = pressure at outlet of flow control valve p₃ = pressure at outlet of Combi valve

Manual control DN 10...32

The manual control knob (1) is ready fitted to protect valve stem and pre-set mechanism and facilitates manual control of the Combi valve during commissioning.

Factory setting:

The valve is open. To close the valve, turn the manual knob clockwise.

The valve must be open to purge the system.



Product no.	Stock no.		Description
ALE10	ALE10		Electronic manometer excluding measuring lines and measuring tips. Measuring range 0-700 kPa. A differential pressure of more than 1000 kPa will destroy the pressure sensor. For measuring the differential pressure between P+ and P- of the Combi valves (refer to diagram under "Functional principle" on page 3). Functions of the manometer: • Start/stop • Automatic zero position • Backlit display • Display: Out → outside the measuring range • Holding function
ALE11	ALE11	Q	Measuring lines and straight measuring tips for use with Siemens Combi valves. Equipped with G $\frac{1}{8}$ " connection with 2 x 40 mm needles.
ALP45	ALP45		Spare nipples P/T port (set of 2) Set contains 1 piece each with a red and blue ribbon. Port: External threads G 1/8" to ISO 228 Connection to valve body: G 1/4" to ISO 228, inclusive O-ring Length: 40 mm
ALP46	S55264-V115		Blanking plug for P/T ports Connection to valve body: G 1/4" to ISO 228, inclusive O-ring
ALP47	S55264-V116		Drain ball valve inclusive O-ring Port: External threads G ½" to ISO 228 Connection to valve body: G ¼" to ISO 228, inclusive O-ring Length: 48 mm
ALP48	S55264-V117	Stephen .	Combined P/T port and drain ball valve with red ribbon Port: External threads G 1/8" to ISO 228 Connection to valve body: G 1/4" to ISO 228, inclusive O-ring Length: 80 mm
ALP49	S55264-V118	11	Long P/T ports (set of 2 pieces) Set contains 1 piece each with a red and blue ribbon. Port: External threads G 1/8" to ISO 228 Connection to valve body: G 1/4" to ISO 228, inclusive O-ring Length: 120 mm
ALP50	S55264-V119		Spare black valve protection cap

Engineering example

Basis of calculation

- 1. Determine energy demand Q [kW]
- 2. Determine temperature differential ΔT [K]
- 3. Calculate volumetric flow

$$\dot{v} = \frac{Q[kW] \cdot 1000}{1,163 \cdot \Delta T[K]} \begin{bmatrix} I \\ h \end{bmatrix}$$

- 4. Select suitable Combi valve
 - pipe connections (internally or externally threaded)
 - with or without P/T ports
- 5. Determine dial setting using volumetric flow/dial presetting table, see the following page

Example

1. Given is a heat exchanger with

$$Q = 1.9 \, kW$$

- 2. Temperature differential (supply return)
- $\Delta T = 6 K$

$$\dot{v} = \frac{1,9kW \cdot 1000}{1,163 \cdot 6 \ K} = 272,28 \ l/h$$

Hint: You can also determine the volumetric flow using the valve slide rule.

- 4. The valve shall have connections with external threads to ISO 228-1 and size DN 15.
- 5. Combi valve selection:

Ideally, Combi valves should be selected such that they operate at about 80% of their maximum flow, enabling them to deliver spare capacity, if required. VPP46.15L0.6 (externally threaded connections, no pressure test points P/T, nominal volumetric flow 600 l/h)

6. Determine dial setting using volumetric flow/dial presetting table below:

Volumetric flow 270 l/h

Dial setting 1.8

Volumetric flow/dial presetting

Tables to determine the dial setting for a desired volumetric flow.

Dp min [kPa] based on volumetric flow; interpolate missing values.

Note

The presetting tables indicate the expected nominal volumetric flow. During commissioning, check whether current pre-settings correspond to the planned design. Further adjustment of the pre-settings may be required to achieve the needed volumetric flow.

Presetting range linear to VDI/VDE 2173
Presetting range linear

Presetting range not permitted

VPP46.10L0.	2, VP	P46	.10L	0.2Q,	VPP46.1	15L0.2	2, VPP	46.15	L0.2Q	, VPI4	6.15L	0.2, V	PI46.1	15L0.2	Q

200 I/h nominal

∨ [l/h]				30	35	40	50	60	70	80	90	100	110	120	130	140	150	160	170	180	190	200
Dial	Min.	0.2	0.4	0.5	0.6	8.0	1	1.2	1.4	1.6	1.8	2	2.2	2.4	2.6	2.8	3	3.2	3.4	3.6	3.8	Max.
Δpmin [kPa]				14.3	14.3	14.3	14.5	14.6	14.6	14.7	14.8	14.9	15	15.1	15.2	15.3	15.4	15.5	15.5	15.6	15.7	15.8

VPP46.10L0.4, VPP46.10L0.4Q with STA..

330 I/h nominal

Ÿ [l/h]					59	75	91	107	123	140	161	172	188	203	220	236	252	268	284	301	317	333
Dial	Min.	0.2	0.4	0.5	0.6	8.0	1	1.2	1.4	1.6	1.8	2	2.2	2.4	2.6	2.8	3	3.2	3.4	3.6	3.8	Max.
Δpmin [kPa]					14.6	14.7	14.8	15	15.1	15.3	15.5	15.6	15.7	15.8	16	16.1	16.2	16.4	16.5	16.6	16.8	16.9

VPP46.10L0.4, VPP46.10L0.4Q

370 l/h nominal

ൎ [l/h]					65	83	101	119	137	155	179	191	209	226	244	262	280	298	316	334	352	370
Dial	Min.	0.2	0.4	0.5	0.6	8.0	1	1.2	1.4	1.6	1.8	2	2.2	2.4	2.6	2.8	3	3.2	3.4	3.6	3.8	Max.
Δpmin [kPa]					14.6	14.8	14.9	15.1	15.3	15.4	15.6	15.7	15.9	16	16.2	16.3	16.5	16.6	16.7	16.9	17	17.2

VPP46.15L0.6, VPP46.15L0.6Q, VPI46.15L0.6, VPI46.15L0.6Q

600 I/h nominal

∨ [l/h]				100	115	130	160	180	210	240	270	300	320	350	380	410	440	460	490	520	550	575
Dial	Min.	0,2	0,4	0,5	0.6	8.0	1	1.2	1.4	1.6	1.8	2	2.2	2.4	2.6	2.8	3	3.2	3.4	3.6	3.8	Max.
Δpmin [kPa]			·	14.9	15.2	15.5	15.6	15.9	16.1	16.4	16.6	16.8	17	17.2	17.5	17.6	17.8	18	18.2	18.4	18.6	18.9

VPP46.20F1.4, VPP46.20F1.4 Q with STA.., VPI46.20F1.4, VPI46.20F1.4Q with STA..

1200 I/h nominal

∨ [l/h]					200	260	310	380	430	490	550	610	660	730	780	840	900	960	1010	1070	1130	1190
Dial	Min.	0.2	0.4	0.5	0.6	8.0	1	1.2	1.4	1.6	1.8	2	2.2	2.4	2.6	2.8	3	3.2	3.4	3.6	3.8	Max.
Δpmin [kPa]					16	16.5	17	17.5	17.9	18.4	18.8	19.2	19.5	19.9	20.2	20.4	20.7	20.9	21.1	21.3	21.4	21.6

VPP46.20F1.4, VPP46.20F1.4Q, VPI46.20F1.4, VPI46.20F1.4Q

1400 l/h nominal

Ÿ [l/h]					220	290	350	420	480	550	610	680	740	810	870	940	1000	1070	1130	1200	1260	1330
Dial	Min.	0.2	0.4	0.5	0.6	8.0	1	1.2	1.4	1.6	1.8	2	2.2	2.4	2.6	2.8	3	3.2	3.4	3.6	3.8	Max.
Δpmin [kPa]					16	16.5	17	17.5	17.9	18.4	18.8	19.2	19.5	19.9	20.2	20.4	20.7	20.9	21.1	21.3	21.4	21.6

VPP46.25F1.8, VPP46.25F1.8Q, VPI46.25F1.8, VPI46.25F1.8Q with STA..

1530 I/h nominal

∨ [l/h]					238	303	366	427	488	550	614	680	749	822	898	978	1063	1150	1241	1335	1432	1530
Dial	Min.	0.2	0.4	0.5	0.6	0.8	1	1.2	1.4	1.6	1.8	2	2.2	2.4	2.6	2.8	3	3.2	3.4	3.6	3.8	Max.
Δpmin [kPa]					15.3	15.8	16.1	16.4	16.7	17	17.5	18	18.7	19.7	20.9	22.3	24.2	26.4	28.9	32.0	35.4	39.4

VPP46.25F1.8, VPP46.25F1.8Q, VPI46.25F1.8, VPI46.25F1.8Q

1800 l/h nominal

∨ [l/h]					280	356	430	502	574	647	722	800	881	967	1057	1151	1250	1353	1460	1571	1685	1800
Dial	Min.	0.2	0.4	0.5	0.6	0.8	1	1.2	1.4	1.6	1.8	2	2.2	2.4	2.6	2.8	3	3.2	3.4	3.6	3.8	Max.
Δpmin [kPa]					15.3	15.8	16.1	16.4	16.7	17	17.5	18	18.7	19.7	20.9	22.3	24.2	26.4	28.9	32.0	35.4	39.4

VPP46.32F4, VPP46.32F4Q, VPI46.32F4, VPI46.32F4Q with STA..

3400 l/h nominal

	Ÿ[[l/h]					468	680	770	940	1120	1290	1460	1640	1810	1980	2150	2330	2500	2670	2850	3020	3190	3400
Ī	Di	ial	Min.	0.2	0.4	0.5	0.6	8.0	1	1.2	1.4	1.6	1.8	2	2.2	2.4	2.6	2.8	3	3.2	3.4	3.6	3.8	Max.
I	Δpmir	ı [kPa]					17.9	18	18.1	18.2	18.3	18.5	18.7	18.9	19.2	19.6	20.1	20.7	21.4	22.3	23.4	24.6	26	28

VPP46.32F4, VPP46.32F4Q, VPI46.32F4, VPI46.32F4Q

4000 I/h nominal

L	ൎ [l/h]					550	800	910	1110	1320	1520	1720	1930	2130	2330	2530	2740	2940	3140	3350	3550	3750	4001
ſ	Dial	Min.	0.2	0.4	0.5	0.6	8.0	1	1.2	1.4	1.6	1.8	2	2.2	2.4	2.6	2.8	3	3.2	3.4	3.6	3.8	Max.
	Δpmin [kPa]					17.9	18	18.1	18.2	18.3	18.5	18.7	18.9	19.2	19.6	20.1	20.7	21.4	22.3	23.4	24.6	26	28

VPI46.40F9.5Q

9500 I/h nominal

∨ [l/h]					1370	1600	1950	2250	2650	3000	3400	3800	4250	4750	5250	5800	6350	6950	7550	8200	8800	9500
Dial	Min.	0.2	0.4	0.5	0.6	8.0	1	1.2	1.4	1.6	1.8	2	2.2	2.4	2.6	2.8	3	3.2	3.4	3.6	3.8	Max.
Δpmin [kPa]					10	10	10	10	10	10	10	11	11	12	13	15	16	18	20	22	24	25

VPI46.50F12Q

11500 I/h nominal

VI 1-0.501 12	u.																			1150	0 1/11 110	minai
∨ [l/h]					1400	1650	2000	2350	2700	3150	3550	4050	4600	5150	5800	6500	7300	8150	9000	9800	10600	11500
Dial	Min.	0.2	0.4	0.5	0.6	0.8	1	1.2	1.4	1.6	1.8	2	2.2	2.4	2.6	2.8	3	3.2	3.4	3.6	3.8	Max.
Δpmin [kPa]					10	10	11	11	11	12	12	13	14	15	17	19	21	24	27	30	33	36

Engineering notes

Valve	Symbols / Dir	ection of flow	Flow in control mode	Valve	stem
	VP46	VP46Q		retracts	extends
Combi valve VPP46	4855207	4665200	variable	closes	opens
Combi valve VPI46	4655209	48562710	variable	closes	opens



The direction of flow indicated (arrow on the valve body) is mandatory!

The valves should preferably be mounted in the return pipe where temperatures are lower and where the sealing gland is less affected by strain.

Symbols

Symbol used in catalogs and application descriptions	Symbol used in diagrams
4855711	There are no standard symbols for Combi valves in diagrams.

Recommendation

A strainer or dirt trap should be fitted upstream of the valve to enhance reliability. Remove dirt, welding beads etc. from valves and pipes.

Do not insulate the actuator bracket, as air circulation must be ensured!


Mounting notes

Combi valve and actuator can be straightforwardly assembled on site. Special tools or adjustments are not required.

Prior to mounting the actuator, the required volumetric flow must be set.

The valve is supplied complete with Mounting Instructions (74 319 0649 0 b).

Mounting positions




Thermal actuators STA.., STP.. may be installed in any position.

Actuators SSA., SAY., must be installed horizontally up to 90° and not hanging.

AL60 supporting ring

The AL60 supporting ring must be put into position before mounting the actuator SUA21/3 onto the valve.



Prior to mounting the actuator, the presetting is to be made as follows:


Presetting DN 10...32:

Remove control knob from Combi valve.




Presetting DN 40...50:


1. Loosen spindle head




2. Loosen knurled nut.




2. Adjust the desired dial setting with the white knob.




3. Adjust the desired dial setting with the white knob.




3. Retighten spindle head by hand only



4. Retighten knurled nut by hand.



Valve characteristic VP..46.., VP..46..Q



Commissioning notes



The valves must be commissioned with the manual control knob or actuator correctly fitted. Strong pressure impacts can damage closed Combi valves.



The Combi valves have to be open when flushing or pressure testing the system. Flush only in correct flow direction. Strong pressure impacts can damage closed Combi valves.



Differential pressure Δp_{max} across the valve's control path is not allowed to exceed 600 kPa.

Manual control

When turning the manual control knob in counter-clockwise direction or manually operating the actuator, the valve opens. The actuator closes the valve. The valves are supplied fully open. The manual knob is not designed for permanent manual operation.

Maintenance notes



The V..P46.. PICV valves are maintenance-free without cartridge. Valve plug, stem, presetting, diaphragm etc. may not be disassembled When performing service work on the valve and / or actuator:

- Switch off the pump and disconnect power supply.
- Close the shut-off valves in the piping network.
- Fully reduce pressure in the piping network and allow the pipes to cool down completely.

Remove the electrical connections only if necessary.

Sealing gland

The stem sealing gland cannot be exchanged. Should leakage occur, the whole valve must be replaced.

Disposal

Do not dispose of the device as household waste.

△ Warning

Due to the tensioned spring return, valve disassembly may result in flying parts causing possible injury.

Only authorized staff may disassemble valves with tensioned spring return!

Disposal

- Special handling of individual components may be mandated by law or make ecological sense.
- Observe all local and currently applicable laws and regulations.

Warranty

Application-related technical data are guaranteed only when the valves are used in connection with the Siemens actuators listed under "Equipment combinations" on page 3. When used with actuators of other manufacture, any warranty by Siemens becomes void.

Technical data

Functional data	PN class	PN 25 as per EN 1333
	Permissible operating pressure	2.500 kPa (25 bar) as per ISO 7628 / EN 1333
	Max. differential pressure	600 kPa
	Min. differential pressure	See tables volumetric flow/dial presetting
	Valve characteristic	Linear as per VDI/VDE 2173
	Leakage rate in general	Class IV (00.01% of volumetric flow V_{100}) to EN 1349
	DN 2532 with STA3	Class III $(00,1\%$ of volumetric flow $V_{100})$ per EN 1349
	Average flow accuracy	+/-10% from ΔPmin - to 2.5 x ΔPmin
	•	+/- 5% from 2.5 x ΔPmin – to 600kPa

	Permissible media		Low-temperature hot water, chilled water, water			
				antifreeze	\\\\\\\\\\\\\\\\\\\\\\\	
	Medium temperature:		Recoi	mmendation:	Water treatment to VDI 2035	
	Valve with actuator		1120 °C			
	raire min detauter		1110°C with SUA21/3³), SUA21/3P, SUE21P			
	Permissible ambient ter	nperature	150		<u> </u>	
	Nominal stroke	DN 10L0.2				
		DN 15L0.2	2.5 m	ım		
		DN 15L0.6				
	DN 10	L0.4 / DN 20				
	DN 2532 DN 4050					
Materials	Valve body, port, seat,		15 mr Dezin		stant hot-pressed brass	
	and test points	· · · · · · · · · · · · · · · · ·), CW602N		
	Valve body DN 4050		Nodul	lar cast iron		
	Stem, spring			Stainless steel		
	Presetting element			PTFE, PPO, POM C and ABS		
	Regulator		PPS			
	Seals			EPDM 281 (O-ring)		
Dimensions / weight	Dimensions		Refer	to "Dimensio	ns" on page 14	
	Threaded connections	VPP46	G 1	to ISO 228-1	(externally threaded)	
		VPI46	Rp 1	to ISO 7-1	(internally threaded)	
	Actuator connection	DN 1032	M30 >	x 1.5 mm		
		DN 4050	Siemens large stroke connector			
	Pressure test points (P/T-ports)			G 1/4" (connection valve body)		
			2 mm x 40 mm (needles)			
	Weight			Refer to "Dimensions" on page 14		
Standards, directives and ap-	Pressure Equipment Di	rective	PED 2014/68/EU			
provals	Pressure-carrying acco	essories	Scope: Article 1, section 1 Definitions: Article 2, section 5			
	Eluid group 2					
	Fluid group 2	DN 1040	Without CE-marking as per article 4, section 3 (sound engineering practice) 1)			
			Category I, Modul A, with CE-marking			
		DN 50	as per article 14, section 2			
	EU conformity (CE)	DN 50	A5W0	00022837, CE	E1T4855xx ²⁾	
	EAC conformity		Euras	sia conformity		
Environmental compatibility		design and a	ssessn	ments (RoHS	ontains data on environmen- compliance, materials com-	

 $^{^{1)}}$ Valves where PS x DN < 1000, do not require special testing and cannot carry the CE label.


²⁾ Documents are available at http://www.siemens.com/bt/download

³⁾ Only with mounting AL60 accessory, the SUA21/3 can drive the VPI46.. or VPP46..valve

Combi valves in HVAC systems combined with variable speed pumps provide even higher energy efficiency. When sizing the pump, it must be made certain that the most critical branch or consumer in the system – usually the remotest from the pump – gets enough pressure (pump head). Thus, it is recommended to use a variable speed pump in constant-pressure mode with end-point feedback, to maintain a minimum differential pressure across the critical valve.

Residential buildings

Residential buildings with for example self-contained flat heating systems:

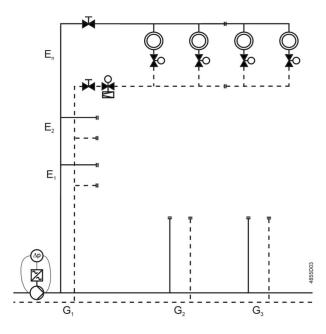



E = Floor


G = Group or zone

Non-residential buildings

Commercial buildings with for example Fan Coil Units or heat exchangers for heating or cooling:

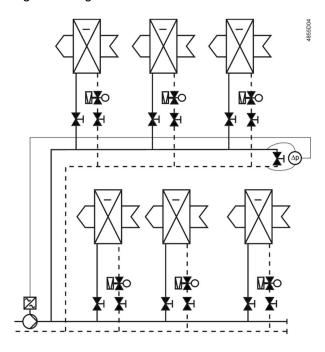

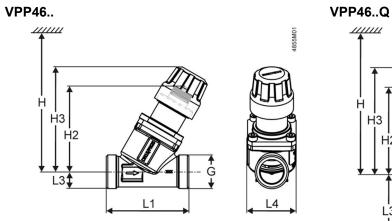



Valves	DN	G	L1	L3	L4	H2	Н3	H 1)		Weight								
								SSA	STA3 STP3									
		[inch]	[mm]	[kg]														
VPP46.10L0.2	10	1/2		10.5		68.5	83.5			0.314								
VPP46.10L0.4	10	/2	65	10.5		00.5	63.5			0.314								
VPP46.15L0.2	15	3/4	65	13.2	38	67.3	82.2	170	160	0.333								
VPP46.15L0.6	15	74		13.2	30	67.3	02.2	170	100	0.555								
VPP46.20F1.4	20	1	70	13.6		67.5	82.5			0.371								
VPP46.25F1.8	25	11⁄4	78	22		70	85			0.497								
VPP46.32F4	32	1½	104	26	63	85	100	185	175	1.22								
VPP46.10L0.2Q	40	1/		54.0		CO F	00.5			0.402								
VPP46.10L0.4Q	10	1/2	65	54.8		68.5	83.5			0.302								
VPP46.15L0.2Q	45	3/4	65		20	07.0	00.0	470	400	0.400								
VPP46.15L0.6Q	15	15	15	15	15	15	15	15	15	74		55.5	38	67.3	82.2	170	160	0.422
VPP46.20F1.4Q	20	1	70	57.3		67.5	82.5			0.459								
VPP46.25F1.8Q	25	11/4	78	59		70	85			0.59								
VPP46.32F4Q	32	1½	104	68	63	85	100	185	175	1.317								


¹⁾ Total height including actuator

Sets of threaded fittings with flat seal ALG2: set of 2 threaded fittings	ALG132 ALG142	pipe side with external R threads	G G G G G G G G G G G G G G G G G G G
	ALG152 ALG152B ALG202 ALG202B ALG252 ALG252B	pipe side with internal Rp threads	RD G G 4847210

Type ALG		for valve type	DN	G	R	Rp	L	т
Malleable cast iron	Brass 1)			[Inch]	[Inch]	[Inch]	[mm]	[mm]
	ALG132	VPP46.10	10	G ½	R 3/8		≈ 24	≈ 9
	ALG142	VPP46.15	15	G ¾	R ½		≈ 29.5	≈ 12
ALG152	ALG152B	VPP46.20	20	G 1		Rp ⅓	≈ 23	≈ 13
ALG202	ALG202B	VPP46.25	25	G 1¼		Rp ¾		
ALG252	ALG252B	VPP46.32	32	G 1½		Rp 1		

¹⁾ Maximum medium temperature 100 °C

• On valve side: cylindrical thread to ISO 228-1, on pipe side: with cylindrical thread to ISO 7-1

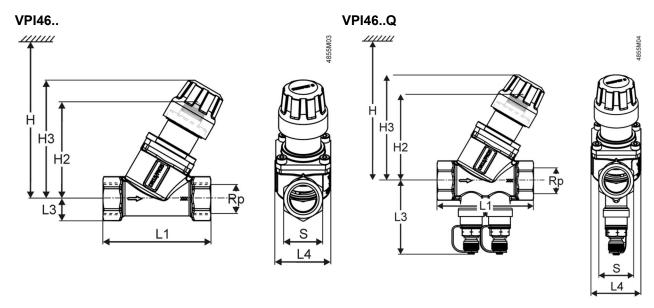

Valves	DN	Rp	S	L1	L3	L4	H2	Н3	H ¹⁾			Weight
									SSA	STA3 STP3	SAY	
		[inch]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[kg]
VPI46.15L0.2	15	1/2	27	75	15.2		67.3	82.4				0.277
VPI46.15L0.6	15	/2	21	75	15.2	38	67.3	02.4	170	160		0.377
VPI46.20F1.4	20	3/4	32	79	17.9	67.5 82.5	170	160	170 160		0.418	
VPI46.25F1.8	25	1	39	83	22		70	85				0.533
VPI46.32F4	32	11⁄4	46	104	26	63	85	100	185	175		1.219
VPI46.15L0.2Q	15	1/2	27	75	60.0		67.2	00.4			-	0.477
VPI46.15L0.6Q	15	/2	21	75	60.2	38	67.3	82.4	170	160		0.477
VPI46.20F1.4Q	20	3/4	32	79	62.9	30	67.5	82.5	170	170 100		0.506
VPI46.25F1.8Q	25	1	39	83	59		70	85				0.625
VPI46.32F4Q	32	11⁄4	46	104	68	63	85	100	185	175		1.316
VPI46.40F9.5Q	40	11/2	56	400	71	00	404				F00	3.253
VPI46.50F12Q	50	2	70	138	77	90	161	-	-	- 500	500	3.683

¹⁾ Total height including actuator

Revision Numbers

Product number	Valid from rev. no.	Product number	Valid from rev. no.
VPP46.10L0.2	A	VPP46.10L0.2Q	A
VPP46.10L0.4	В	VPP46.10L0.4Q	В
VPP46.15L0.2	A	VPP46.15L0.2Q	A
VPP46.15L0.6	A	VPP46.15L0.6Q	A
VPP46.20F1.4	A	VPP46.20F1.4Q	A
VPP46.25F1.8	A	VPP46.25F1.8Q	A
VPP46.32F4	A	VPP46.32F4Q	A
VPI46.15L0.2	A	VPI46.15L0.2Q	A
VPI46.15L0.6	A	VPI46.15L0.6Q	A
VPI46.20F1.4	A	VPI46.20F1.4Q	A
VPI46.25F1.8	A	VPI46.25F1.8Q	A
VPI46.32F4	A	VPI46.32F4Q	A
		VPI46.40F9.5Q	A
		VPI46.50F12Q	A

Documentation form

Installed location	Valve type	Actuator Type	Valve Size	Planned Pre- setting	Required ∆pmin (kPa)	Verified ∆p (kPa)	Flow ¹ (I/h)

 $^{^{1)}}$ Flow = if Verified Δp_{min} > Required Δp_{min} , then Flow is as per presetting in datasheet, otherwise check.

Issued by
Siemens Switzerland Ltd
Smart Infrastructure
International Headquarters
Theilerstrasse 1a
6300 Zug
Switzerland
Tel. +41 58-724 24 24
www.siemens.com/buildingtechnologies

© Siemens Switzerland Ltd, 2019 Technical specifications and availability subject to change without notice.